


Wall mounted damper Model RC400D-C


Submittal

No	Descriptions	Materials
1	Damper Sleeve	Galvanised Steel or Stainless Steel 1.5 - 2.5 thk
2	Hanger Bracket	Galvanised Steel or Stainless Steel 1.5 - 2.5 thk
3	Damper Frame	Galvanised Steel or Stainless Steel 1.2 thk.
4	Fusible Link Bracket	Galvanised Steel or Stainless Steel 1.5 thk.
5	Blade	Galvanised Steel or Stainless Steel 1.0 thk.
6	Fusible Link	Rated at 74°C
7	Duct collar	Galvanised Steel or Stainless Steel 0.5 - 1.2 thk
8	Retaining Angle	Galvanised Steel or Stainless Steel 1.5 - 2.5 thk
9	Reinforce Plate	Galvanised Steel or Stainless Steel 1.5 - 2.5 thk




For round duct collar:
 $W = A + 60 \text{ mm}$
 $H = A + H3 + 30 \text{ mm}$

	A	W	H
Min. size	150	210	210
Max. size	1330	1390	1500




For flat-oval duct collar:
 $W = B + 60 \text{ mm}$
 $H = A + H3 + 30 \text{ mm}$

	A	B	W	H
Min. size	150	150	210	210
Max. size	1330	1440	1500	1500



For rectangular duct collar:
 $W = B + 60 \text{ mm}$
 $H = A + H3 + 30 \text{ mm}$



	A	B	W	H
Min. size	150	150	210	210
Max. size	1330	1440	1500	1500

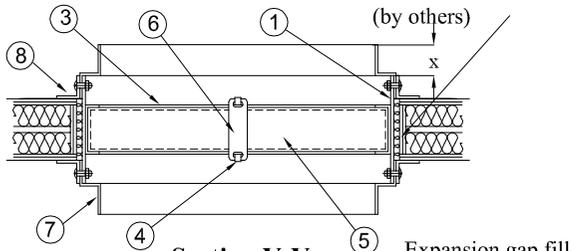


Section Y-Y

Expansion gap filled with high temperature insulation at all round (by others)

Expansion gap filled with high temperature insulation at all round (by others)

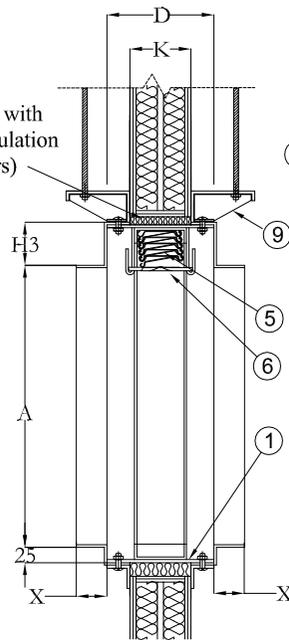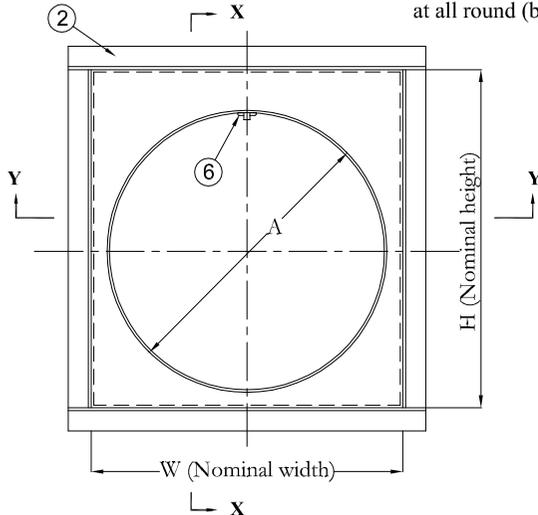

Section X-X
(Damper in open position)

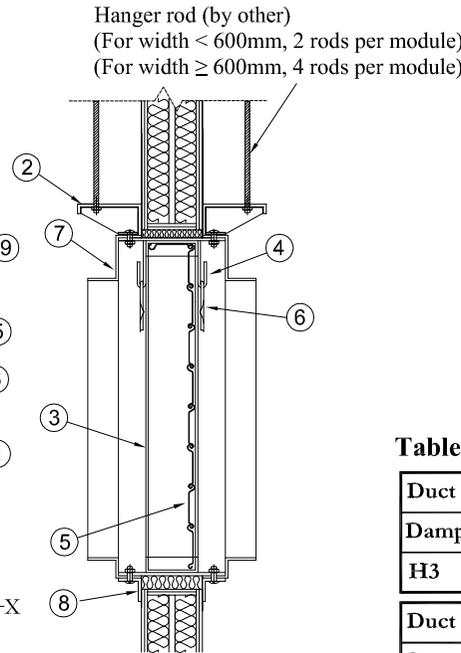

Section X-X
(Damper in close position)

Hanger rod (by other)
 (For width < 600mm, 2 rods per module)
 (For width ≥ 600mm, 4 rods per module)

Notes:

- Damper are available in single module construction only
- K: Wall thickness
 $D: K + 76 \text{ mm}$
- $X=70\text{mm}$ for round and flat-oval duct collar.
 $X=30\text{mm}$ for rectangular duct collar.
- Wall opening = damper size x 1.01+10mm (GI)
 Wall opening = damper size x 1.015 + 10mm (SS304/316)

Example:

For galvanised steel damper with connection duct size Ø650, the opening size shall be calculated as follows:

$$W = 650 + 60 = 710 \text{ mm}$$

From Table 1, H = 750 mm

$$710 \times 1.01 + 10 = 727 \text{ mm}$$

$$750 \times 1.01 + 10 = 768 \text{ mm}$$

hence, min. opening size = 727(W) x 768(H) mm.

For small damper with expansion gap smaller than 19mm, the max. opening size can be based on the expansion gap of 19mm.

Hence min. opening size = 748 (W) x 788 (H) mm.

Table 1:

Duct height, A	150	200	310	360	540	650	690
Damper height, H	210	260	380	445	630	750	800
H3	30	30	40	55	60	70	80

Duct height, A	820	900	1130	1190	1310	1330
Damper height, H	940	1030	1270	1340	1470	1500
H3	90	100	110	120	130	140

In the interest of product improvement, we reserved the right to make changes without notice.

All dimensions are in mm

OLS[®] Manufacturing (S) Co. Pte. Ltd.
 3-B, Joo Koon Circle, Singapore 629034
 Tel.: 68615253 Fax.: 68619850
 email: sales@connols-air.com web: http://www.connols-air.com

Title :

4 hours rated curtain type wall mounted fire damper - Drywall (Model RC400D-C)

Dwn. By :	Edward Chan	Date :	30/12/2019	Scale :
Chk. By :	Han Jee	Dwg. No. :	DAXEP043	N.T.S
App. By :	Wong Wong			

